

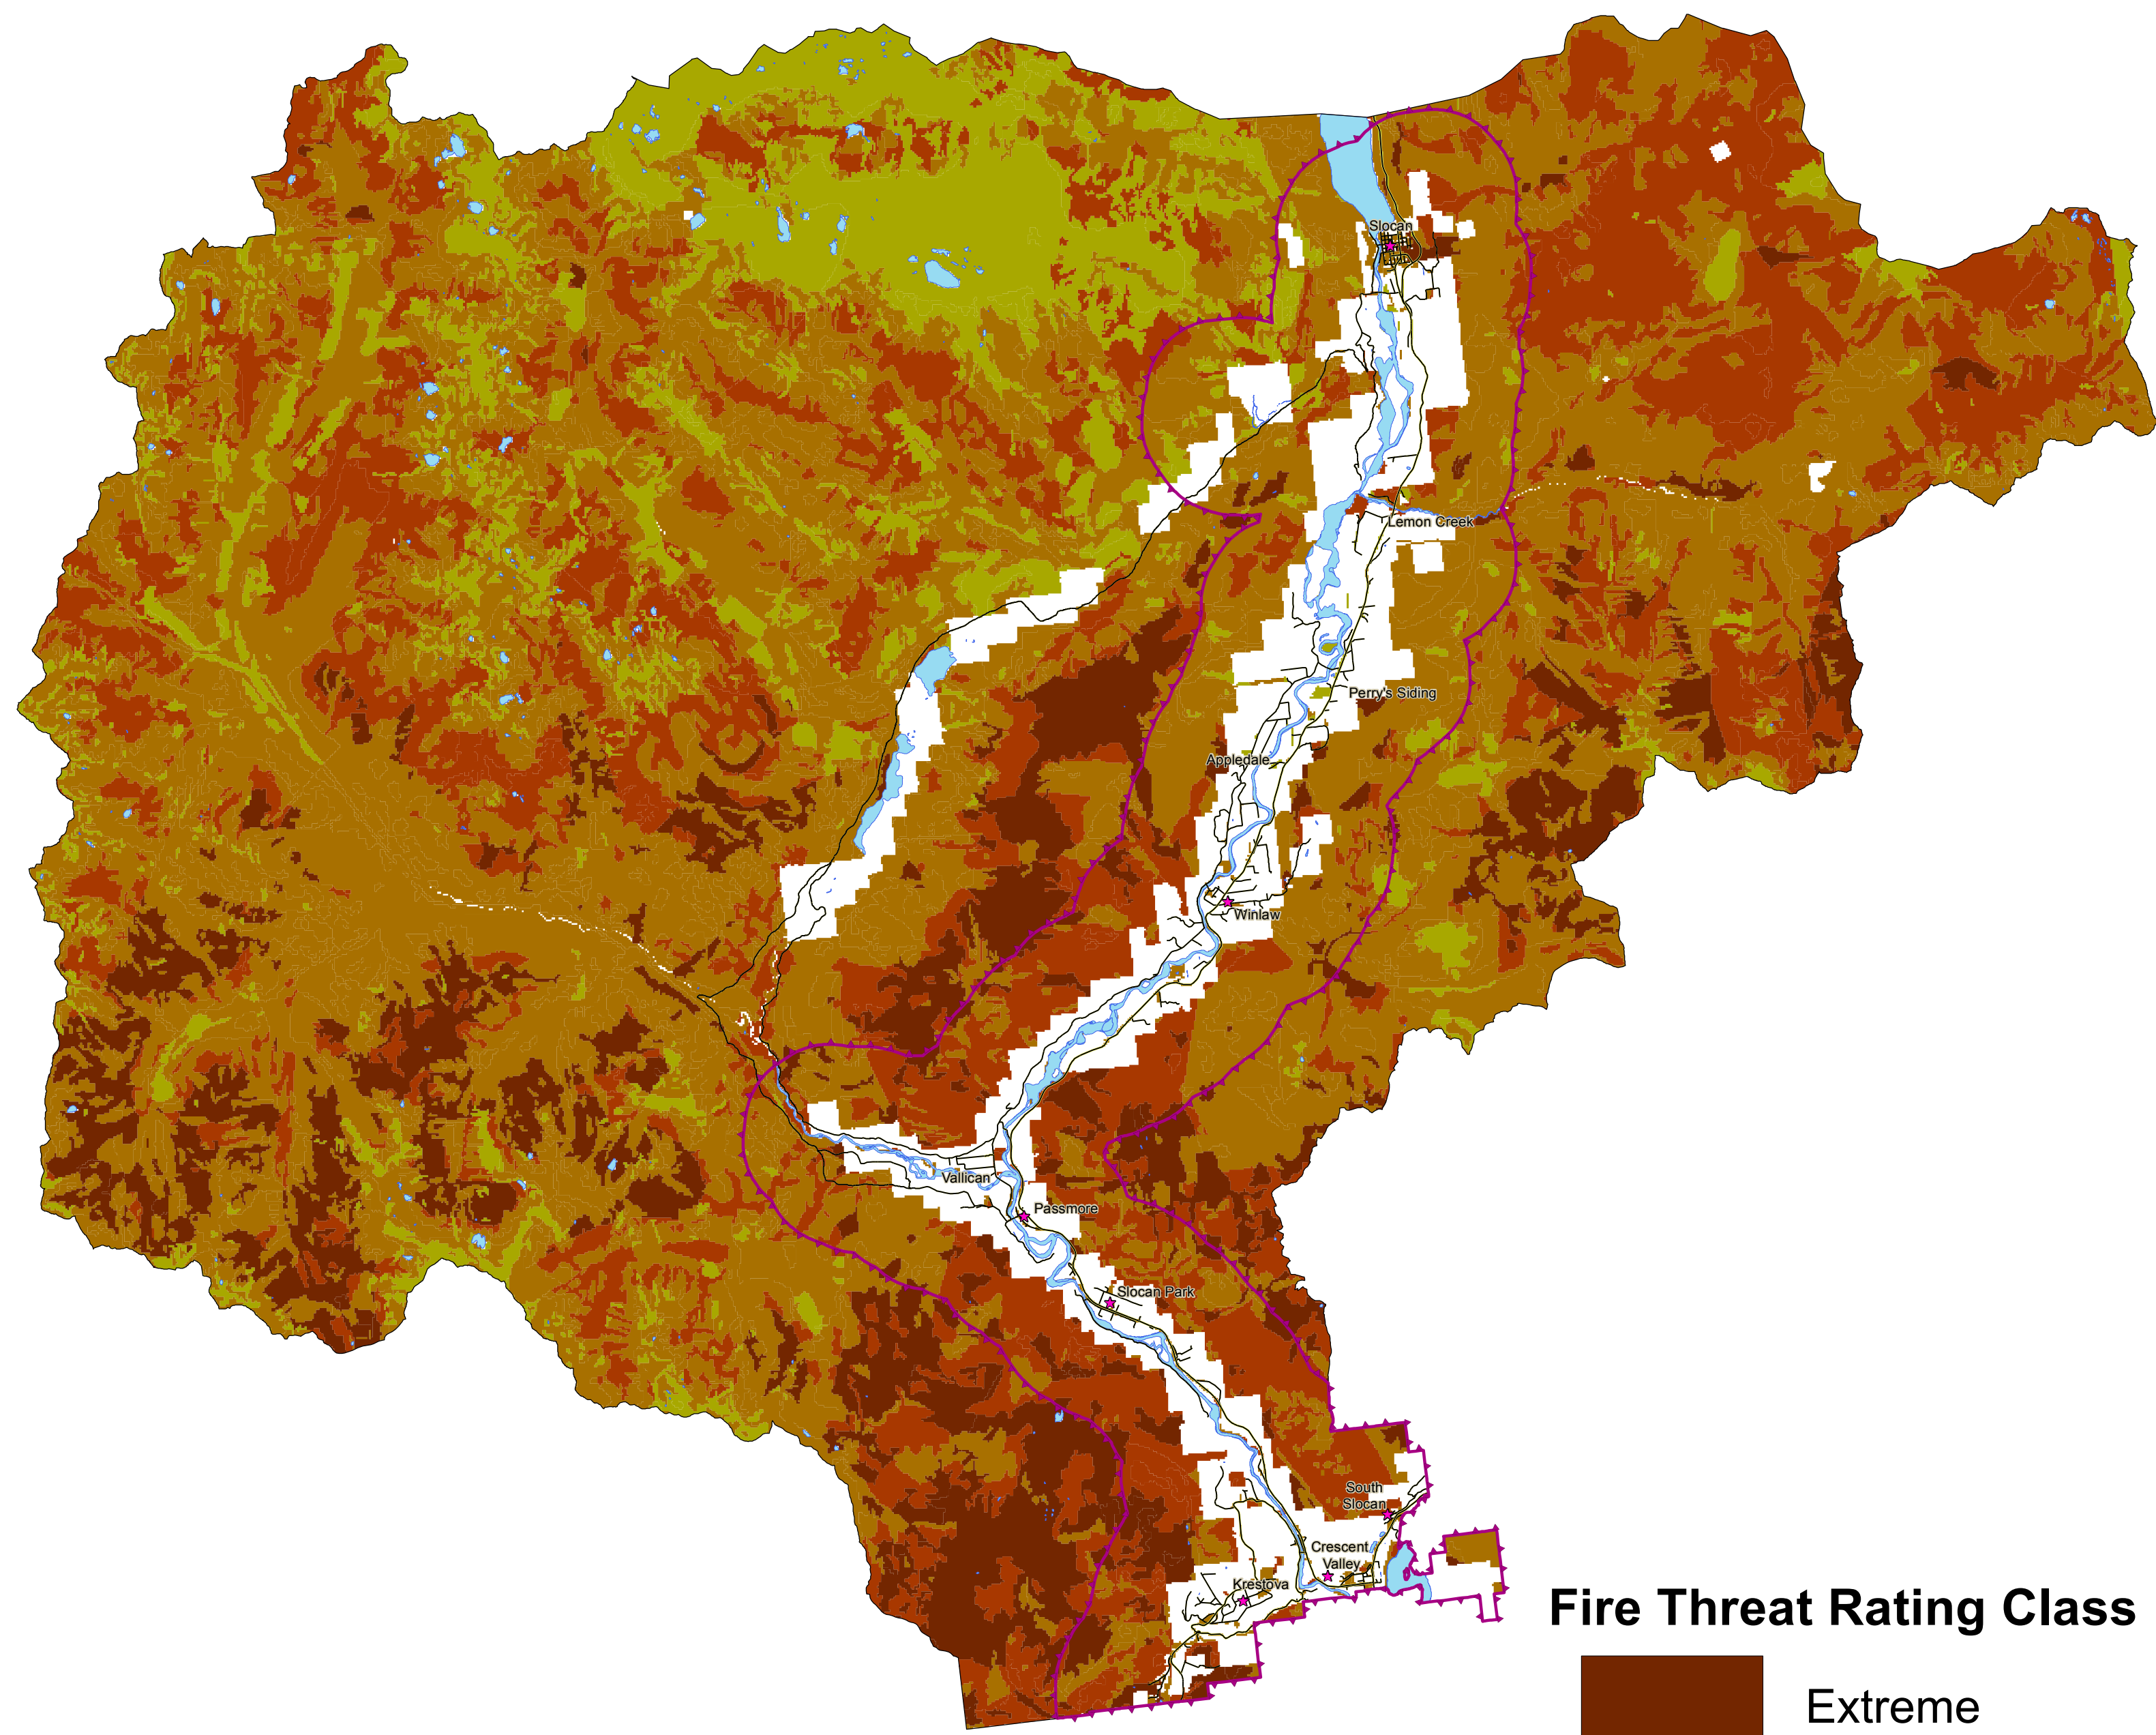
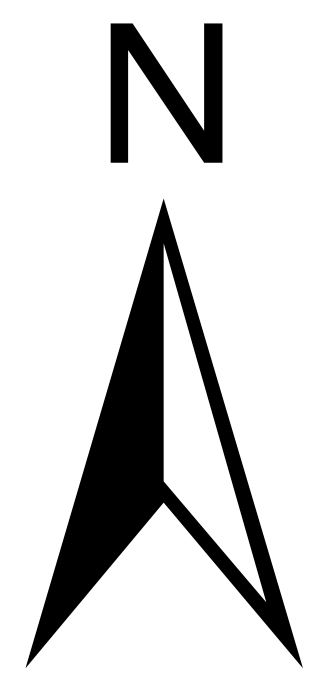


Map 4 Provincial Strategic Threat Analysis for RDCK Area H South

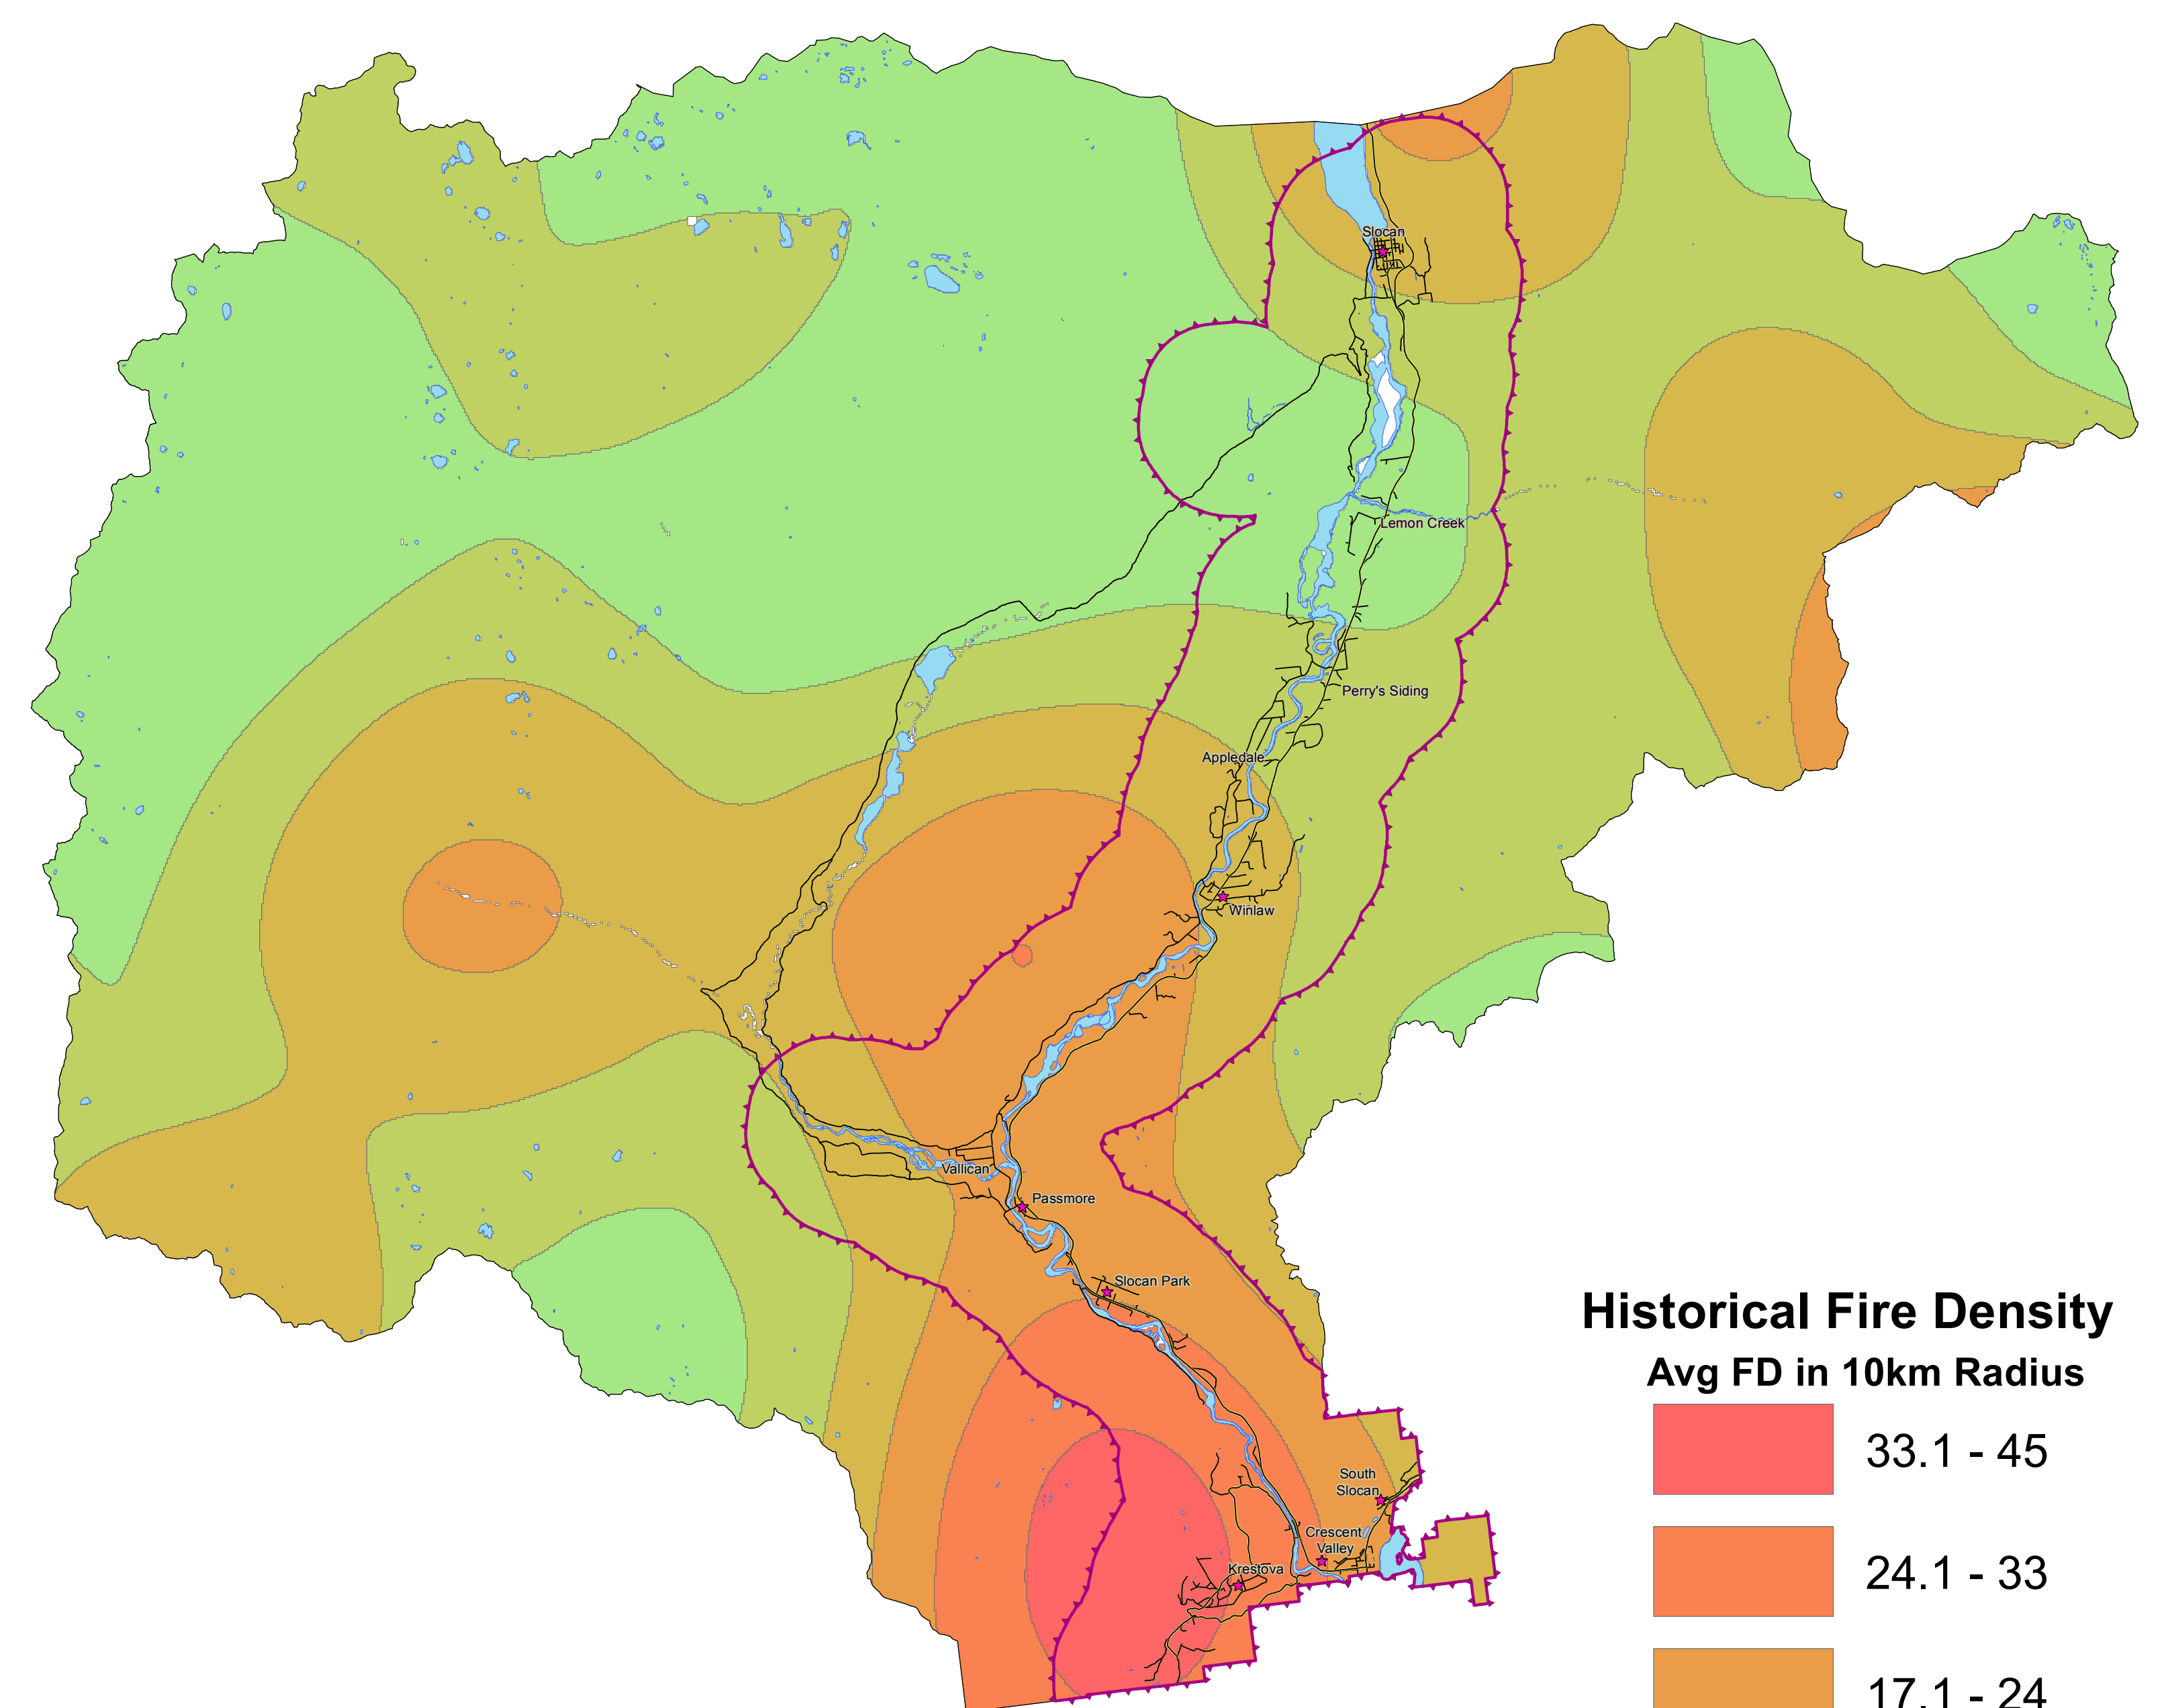

Fire Threat Rating Class



- Extreme
- High
- Moderate
- Low
- No Data

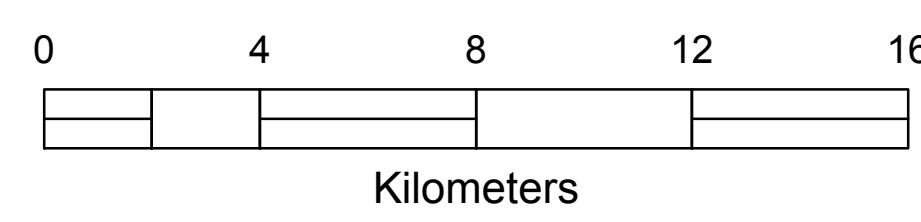

Historical Fire Density



Avg FD in 10km Radius

- 33.1 - 45
- 24.1 - 33
- 17.1 - 24
- 10.1 - 17
- 5.1 - 10
- 1 - 5
- No Data

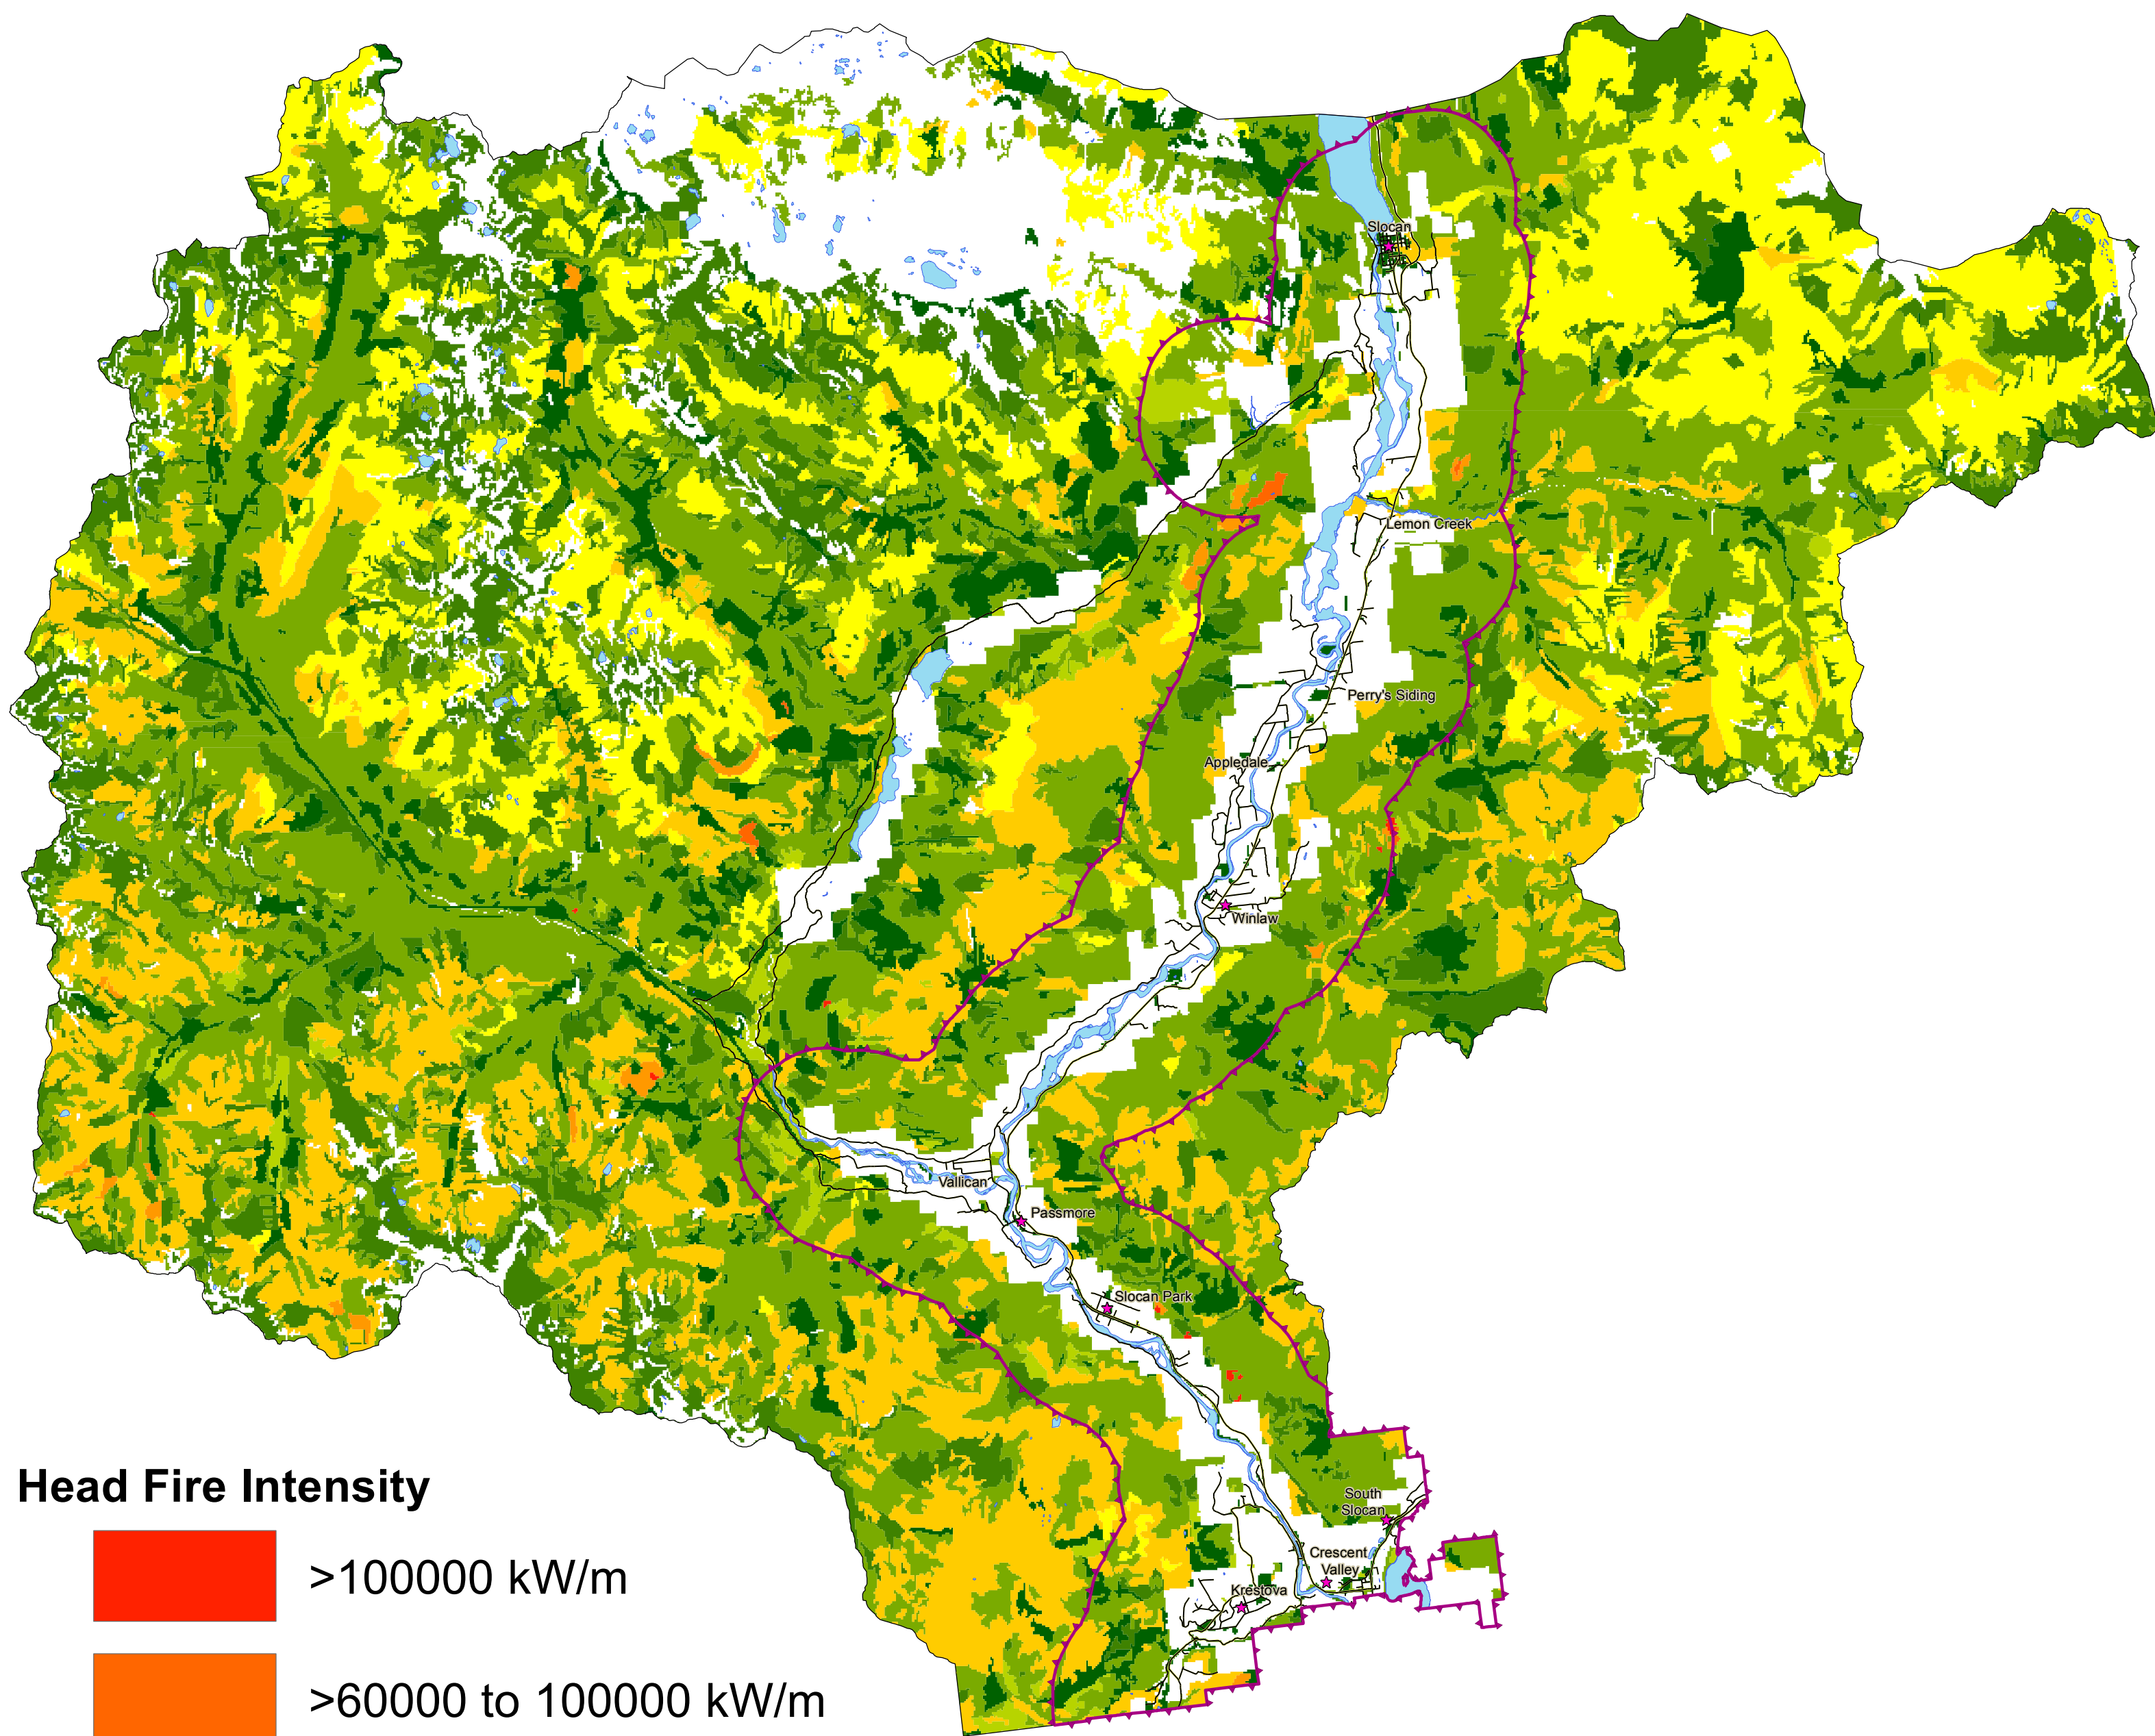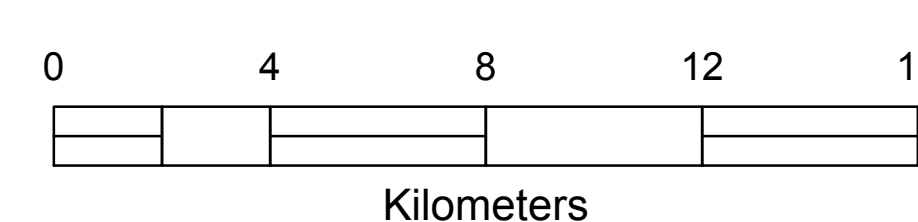


Head Fire Intensity

- >100000 kW/m
- >60000 to 100000 kW/m
- >18000 to 30000 kW/m
- >10000 to 18000 kW/m
- >6000 to 10000 kW/m
- >4000 to 6000 kW/m
- >2000 to 4000 kW/m
- >1000 to 2000 kW/m
- >0 to 1000 kW/m
- No Data

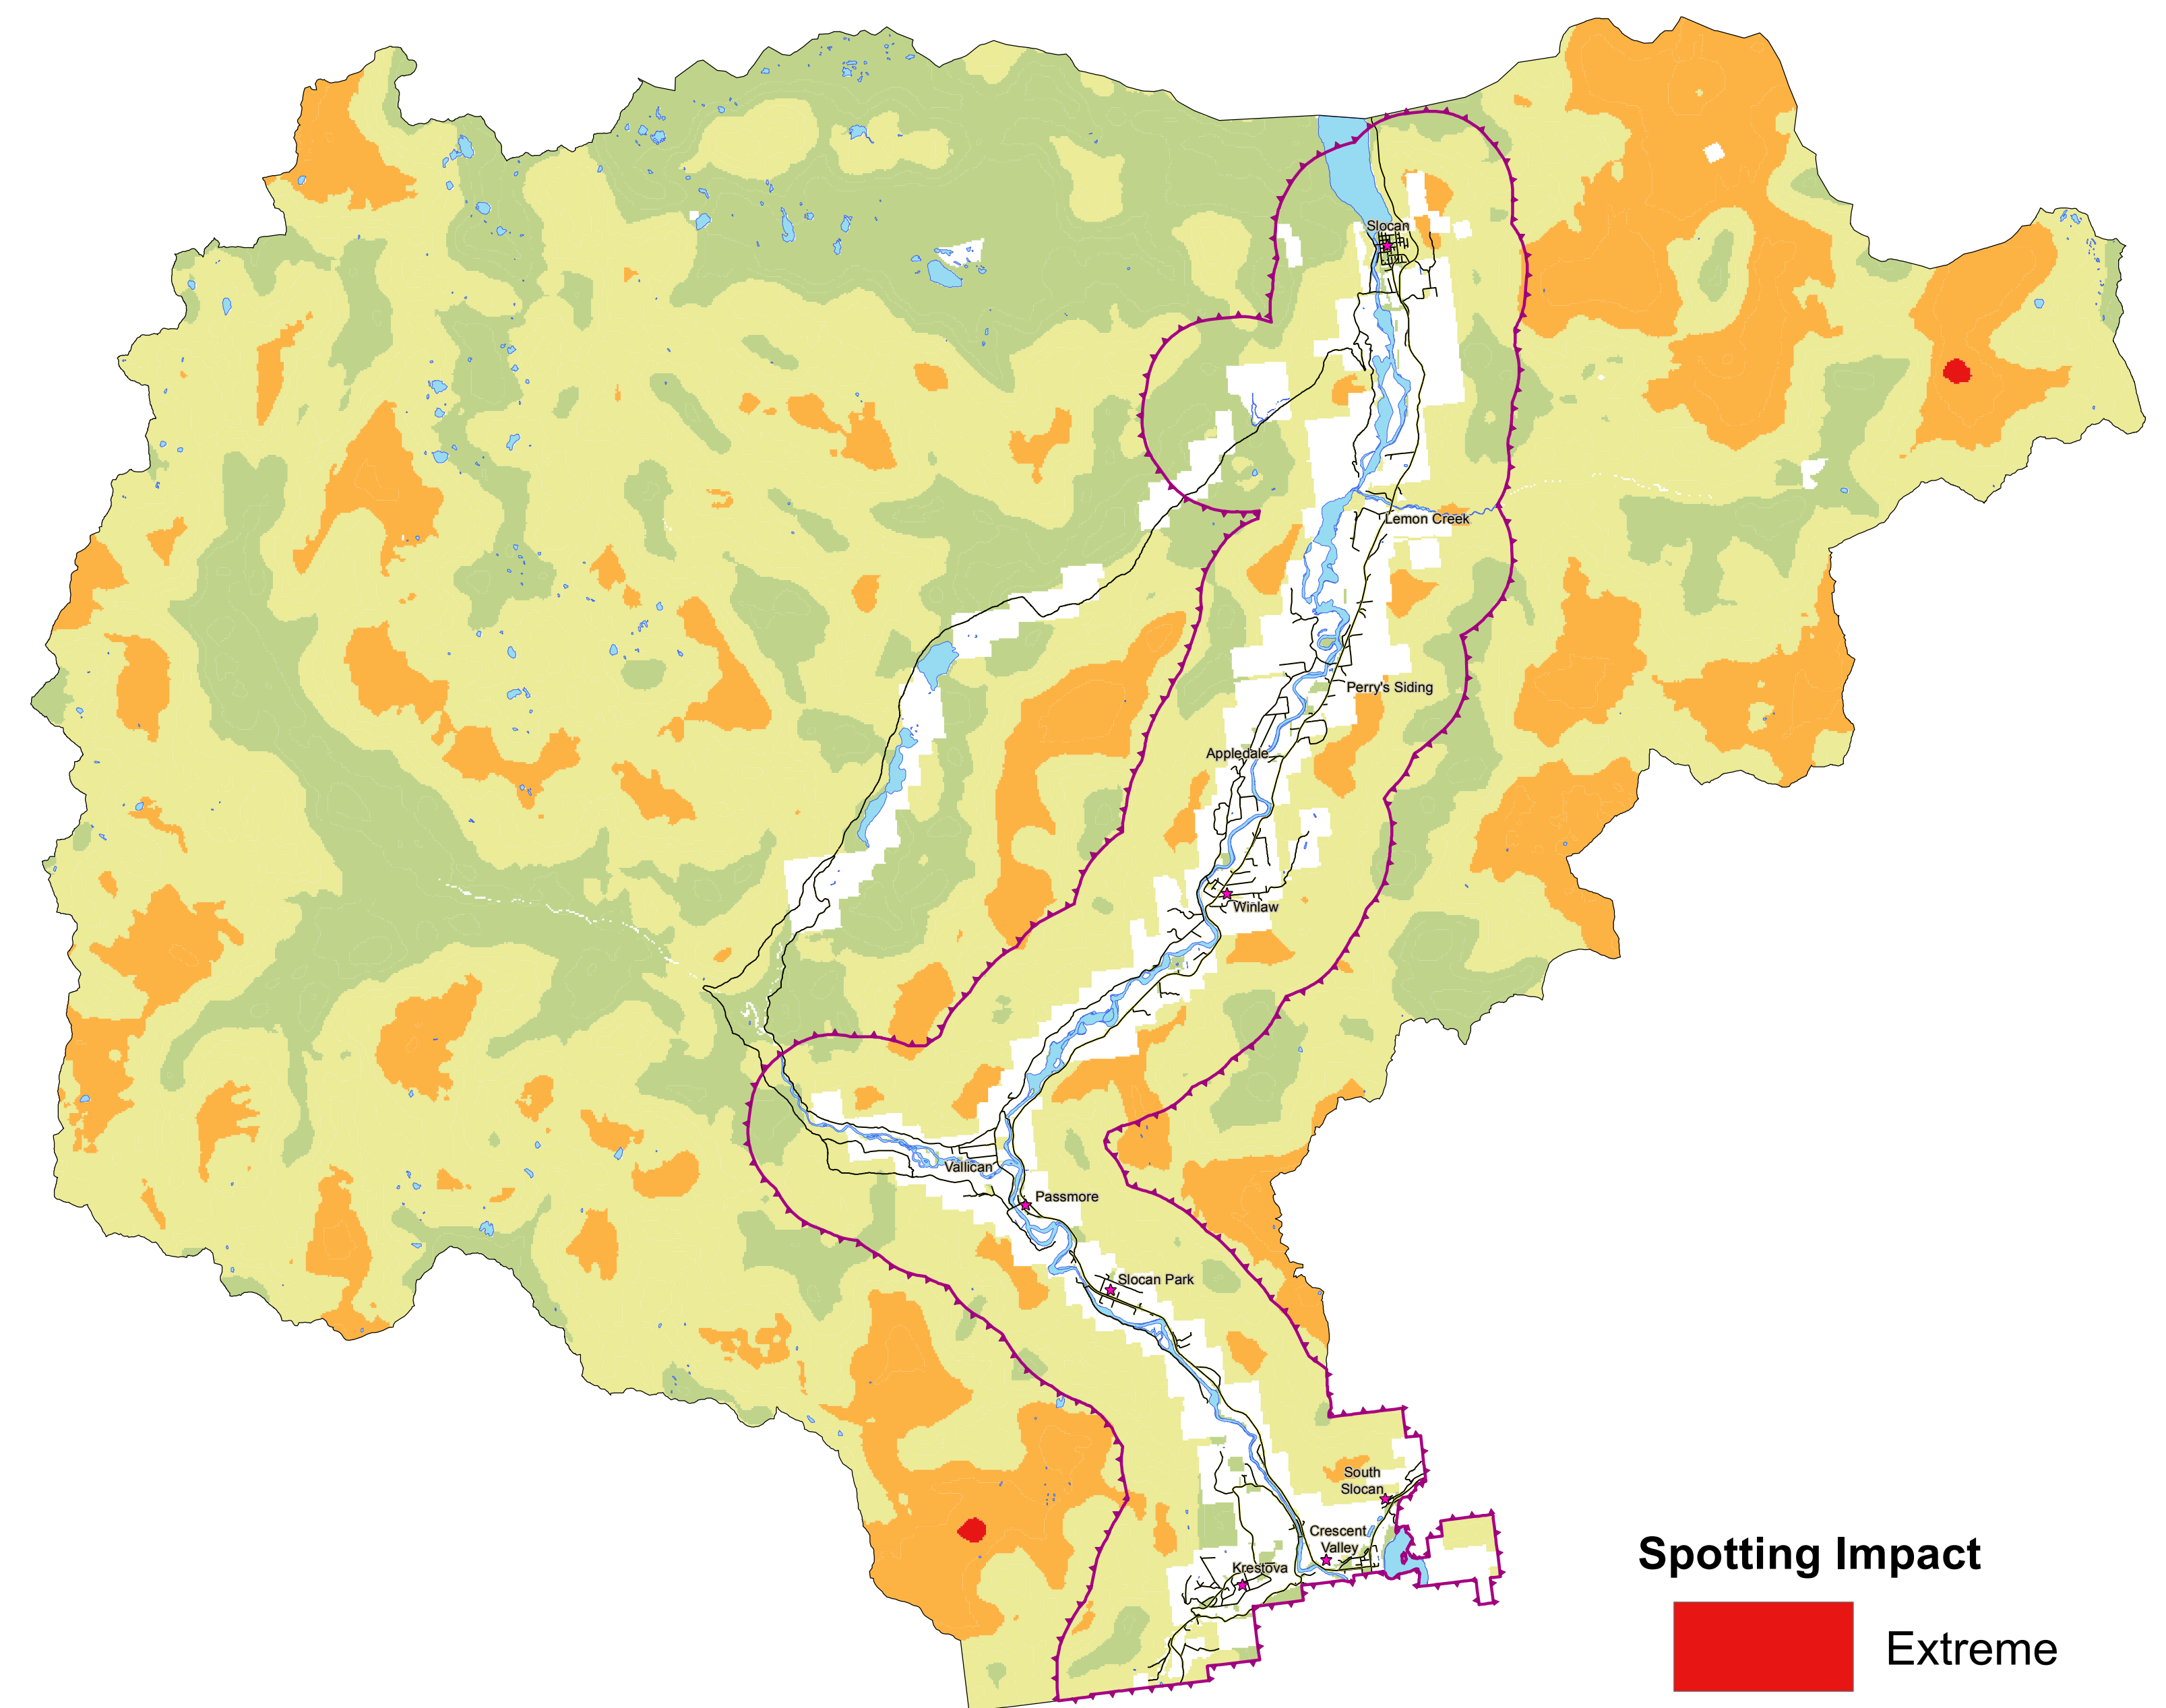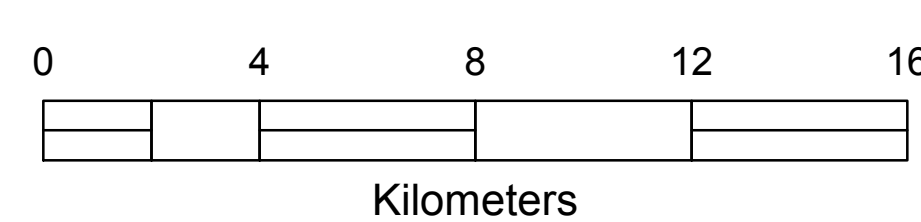

Spotting Impact

- Extreme
- High
- Moderate
- Low
- No Data

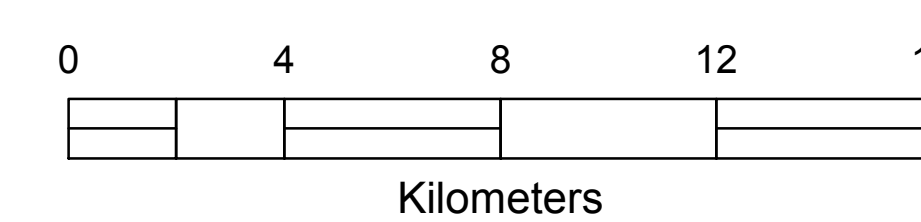


AOI / WUI

Roads

Highway

Local

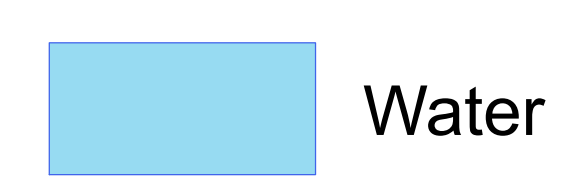

Water



Population Centres



No Data